P.O. Box 291509 Kerrville, Texas USA 78029 Phone: 830.895.4700 Email: pti@power-tronics.com Web: www.power-tronics.com



Specifications

Sensing Voltage: Frequency: Buildup Pullout Voltage: Output Voltage: Maximum Continuous Output: Minimum Field Resistance: Battery Source: Battery Charger: Fusing: Physical Size: Weight: 240vac 50-400Hz 120-150vac 12vdc 40adc 0.3Ω Customer-Supplied 12V battery Customer-Supplied Customer-Supplied 10 x 10 x 5 in. 8 lbs

ABF40 Automatic Battery Flash Unit

The Power-Tronics ABF40 Automatic Battery Flash Unit is a convenient and compact optional automated flashing module for all Power-Tronics SE series Static Exciters. The ABF40 offers an easy method to add a fully automatic battery flash unit to any generator.

The ABF40 is designed specifically for automated battery flashing of rotor-fed and high current exciters. The ABF40 is an optional unit designed specifically for use with Power-Tronics Static Exciters on generators with very low AC residual voltage, brush-type generators, and for any installation where guaranteed buildup is required. Operation is completely automatic and installation into a Power-Tronics regulating system is quick and easy.

The ABF40 Automatic Battery Flash Unit is made with industry standard components to facilitate future maintenance. The components selected are in excess of those required for operation to withstand the harshest environmental conditions and provide extreme reliability. The control relays are housed in steel enclosures to protect against any foreign contaminants that may be present.

The ABF40 Automatic Battery Flash Unit is compatible with all previous and current SE1500, SE2000, SE3000, and SE6000 series Static Exciters. The ABF40 is also a very simple upgrade for installations using Power-Tronics BU120/240, BU500, or AFM500X series buildup modules!



P.O. Box 291509 Kerrville, Texas USA 78029 Phone: 830.895.4700 Email: pti@power-tronics.com Web: www.power-tronics.com

Table of Contents

Introduction and Functional Description:	3
Hookup Diagram:	4
Initial Setup and Commissioning:	5
Application Troubleshooting:	6
Bench Check Procedures:	7
Installation Warranty Form:	B
Product Warranty Certificate:	9

O. Box 291509 Kerrville, Texas USA 78029 Phone: 830.895.4700 Email: pti@power-tronics.com Web: www.power-tronics.com

Introduction and Functional Description

Caution: Read This Installation Manual Carefully and Entirely!

Warning: Do not use digital equipment to read voltage, Hz, or amperage during this installation. Use only Analog sensing equipment! Failure to do so may result in damage to equipment or in personal injury!

ALWAYS perform all setup procedures off-line ALWAYS wear eye protection ALWAYS strip wire insulation properly or use insulated connectors ALWAYS use analog metering equipment when setting up the regulating system ALWAYS ensure the ABF40 receives ample airflow NEVER hold the ABF40 in your hand when energized NEVER install the ABF40 in a place it can get wet or is exposed to the elements NEVER mount the ABF40 over a screw, bolt, rivet, welding seam, or other fastener NEVER disconnect the wiring while the unit is in operation NEVER install a switch in the DC portion of the module's wiring NEVER touch any exposed part of the ABF40 while in operation NEVER USE A DIGITAL FREQUENCY METER (It can give a false reading!)

Functional Description

The ABF40 Automatic Battery Flash Unit is a proven design based on industry-standard flashing procedures and safety policies. The ABF40 provides a very compact automatic flashing or battery-flashing source to any Power-Tronics Static Excitation system quickly, easily, and safely.

When the generator is first energized, the voltage regulator typically begins it's buildup mode where it brings the generator up to a given point before it goes into it's regulation mode. Sometimes, however, the generator may have extremely low residual AC voltage or just have a hard time building up. In these situations, the voltage regulator has a difficult time building up the voltage to a point it can regulate. The solution in most situations like this is to flash the generator.

The ABF40 provides a fully automatic method to flash the generator during startup. Automatic flashing is often used on generators with sliprings and brushes and for generators with very low residual AC voltage (typically less than 3VAC) or in installations where a guaranteed buildup is required, such as hospitals, nursing homes, or correctional facilities.


The ABF40 Automatic Battery Flash Unit is based on time-proven flashing methods and features an extremely robust and reliable design. Both voltage inputs and battery inputs are unfused to attempt to force buildup even during a fault condition. Because of its simplicity and modular design, the ABF40 is quickly and easily serviced should the need ever arise.



Hookup Diagram

This configuration uses an external customer-supplied 12V battery to build the terminal voltage to a point that the automatic voltage regulator can take over and perform its function. The ABF40 will automatically disconnect itself when the sensed voltage reaches approximately 120-150vac.

Take special care to follow the wiring directions precisely! DO NOT use a battery voltage different from that marked on the ABF40 unit! Severe damage to the ABF40 will result!

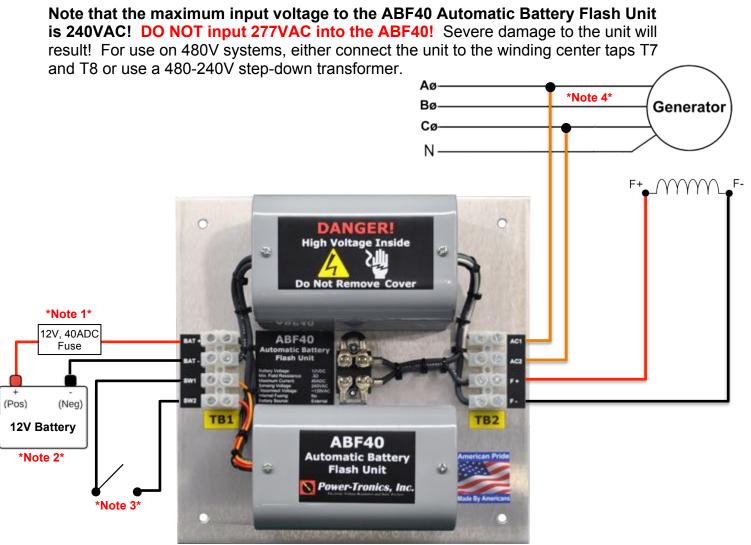

- Note 1: Optional customer-supplied fuse. Rate at no more than 40A @12VDC.
- Note 2: Customer-supplied battery and charging system.
- **Note 3:** Flash-Enable switch. Should be open whenever the exciter is not operating. Rate at 12VDC, 10A or greater.
- **Note 4:** If Using the ABF40 on a 480V or higher generator, connect terminals 1 and 2 to the center taps of the stator leads T7 and T8, or use a step-down transformer as appropriate to supply 240vac to the ABF40.

P.O. Box 291509 Kerrville, Texas USA 78029 Phone: 830.895.4700 Email: pti@power-tronics.com Web: www.power-tronics.com

X 291309 Kentime, Texas OSA 70029 Filone. 050.095.4700 Entail. pri@power-troincs.com web. www.power-

Initial Setup and Commissioning

- 1. Refer to your Static Exciter's instruction manual for initial setup and commissioning of the Static Exciter.
- 2. Wire the ABF40 into your generator and regulating system as shown in the hookup diagram on page 4. The ABF40 is capable of being used on generators with field resistances down to 0.3Ω. Ensure that the battery selected for flashing is isolated and dedicated ONLY to the ABF40. Failure to use an isolated battery can lead to a runaway or loss of control condition!
- 3. Verify that your wiring is correct, and then proceed to test the generator for proper buildup. Start the prime move and bring up to speed, enable the Static Exciter, then close the Flash-Enable switch to verify proper flashing. When satisfactory buildup is achieved installation is complete.

P.O. Box 291509 Kerrville, Texas USA 78029 Phone: 830.895.4700 Email: pti@power-tronics.com Web: www.power-tronics.com

Application Troubleshooting

Problem:	Possible Cause			
No Voltage	1 3 5 7 9 11 13 15 20 22			
Pulsating Voltage	4 5 6 12 16			
Flickering Voltage	4 6 7 14 23			
High Voltage	6 7 8 9 12 13 15 17 18 20 21 23			
Voltage Drop on Load	5 8 10 12 16			
Low Voltage	1 5 8 12 13			
Poor Voltage Regulation	2 4 10 12 13 16			
No Voltage Control	1 13 15 19 20 21 23			

Possible Causes:

- 1. Open or loose connection, poor brush and slip ring contact, fuses are open in the regulator.
- 2. Unbalanced generator load.
- 3. Open exciter field or defective generator.
- 4. Non linear load or defective connection in exciter field.
- 5. Open diode in exciter or shorted rotor in generator.
- 6. Loose component in voltage regulator.
- 7. Loose wiring connections.
- 8. Input voltage to regulator is too low.
- 9. Exciter field is grounded.
- 10. Non linear load or wrong selection for regulator hookup.
- 11. Exciter fields are reversed.
- 12. Wrong selection of regulator wiring configuration.
- 13. Defective voltage regulator.
- 14. SCR or Inverter drive effecting generator waveform.
- 15. Defective ABF40 Automatic Battery Flash Unit.
- 16. Isolation transformer is too small.
- 17. Isolation transformer is needed.
- 18. Exciter fields are not isolated from other circuits.
- 19. Input and field circuit are being fed by a common cable or conduit.
- 20. Incorrect hookup or wiring.
- 21. Exciter field is grounded.
- 22. Drained battery.
- 23. Welded relay contacts.



Bench Test Procedure

If you suspect a problem with your ABF40, it is possible to perform a bench test to verify functionality of the unit and determine if a repair or service is necessary. To perform a bench test on the ABF40, follow the directions below:

- 1. Verify that the battery is connected to terminals BAT + and BAT on TB1 of the ABF40.
- 2. Connect a multimeter capable of reading 12VDC to F+ and F- on TB2 of the ABF40.
- 3. Install a jumper between terminals SW1 and SW2 on TB1. You should read 12VDC at terminals F+ and F- on TB2.
- 4. Apply 240VAC to terminals AC1 and AC2 on TB2. You should hear a click or a buzz and read 0VDC on F+ and F- on TB2.
- 5. Remove the 240VAC from terminals AC1 and AC2 on TB2. You should hear a click and read 12VDC on F+ and F- on TB2.
- 6. Remove the jumper from SW1 and SW2 on TB1. You should read 0VDC on F+ and F- on TB2.

If your ABF40 passed all of the operational tests above, the unit is good. If any one of the tests failed or you are unsure of the result, please contact Power-Tronics for assistance.

P.O. Box 291509 Kerrville, Texas USA 78029 Phone: 830.895.4700 Email: pti@power-tronics.com Web: www.power-tronics.com

Installation Warranty Form

It is very important that you fill out this form completely when installing a voltage regulator. This form serves as a history record on the application. This form also contains the information needed by Power-Tronics, Inc., for repair and troubleshooting of any product you may be having problems with.

Failure to fill out this form during installation will result in a cancellation of your warranty coverage! Filling out this form takes only minutes but will save hours or days later on if your product should require service!

Product			Other options			
Serial Number						
Date of Installation						
Type of Generator	-			Model #		
	Brush type	[]				
	Brushless	[]				
		AC Stato	r Information			
Wired for	Volts	Phase	Hz			
Generator Configurati	ion: Lead					
	1	Exciter/Rot	tor Information		· · · · · · · · ·	
Exciter field resistance		0				0
Exciter field volts		Ω vdc			F+ / F-	Ω Ω
		Vuc		<u>u</u>		
	D	escription of problem	with product or	generator		
				J		
Your phone number			Name:			
Your fax number Ship to Address:			s'			
Your email address			Ship to City, State, Zip:			
				uto, zip.		

P.O. Box 291509 Kerrville, Texas USA 78029 Phone: 830.895.4700 Email: pti@power-tronics.com Web: www.power-tronics.com

PRODUCT WARRANTY

Power-Tronics, Inc., assumes no liability for damages due to incorrect voltage or other voltage related damages resulting from either output of the generator or input to the generator exciter system. These problems should be protected with external devices provided by the customer such as *fuses, surge suppressors, over/under voltage and frequency controls.*

Power-Tronics, Inc., warranties **only parts and workmanship** of this product for a **period of 2 years from the original date of purchase from Power-Tronics, Inc.** Under warranty, Power-Tronics, Inc. will replace, exchange or repair the defective product **without labor or parts cost to the customer.** Remaining warranty of the original product will be transferred to the replaced or repaired product. To obtain warranty, a copy of the original Installation Warranty Form must be sent in with the defective product, which clearly shows the purchase date and serial number of the defective part. A repair request form must be sent in with the product before repairs will begin. You can obtain this form by contacting Power-Tronics, Inc.

Send repairs to: Power-Tronics, Inc., 2802 Cobbler Ln., Kerrville Texas USA 78028.

Send in repairs only by UPS or FedEx. USPS will NOT deliver to our facility!

Any <u>one</u> of the following conditions will void the warranty:

- Overheating of the power supply resistor on the printed circuit card.
- Overheating of the SCR or freewheeling diode.
- Physical damage to the printed circuit card, housing or components.
- Unauthorized repair or alteration of printed circuit card.
- Installation by anyone other than a qualified professional generator service technician.
- Conductive or corrosive contamination of the circuit card.
- Removal of our company identification from the product.
- Removal of any conformal coating of the printed circuit card or components.
- Overheating of foil on the printed circuit card.
- Inappropriate or infeasible application.
- Use with any external device other than manufactured by Power-Tronics, Inc.
- Failure to fill out the attached warranty card during installation

No other warranty is expressed or implied.